



12  
SLOPE 3  
MIN.

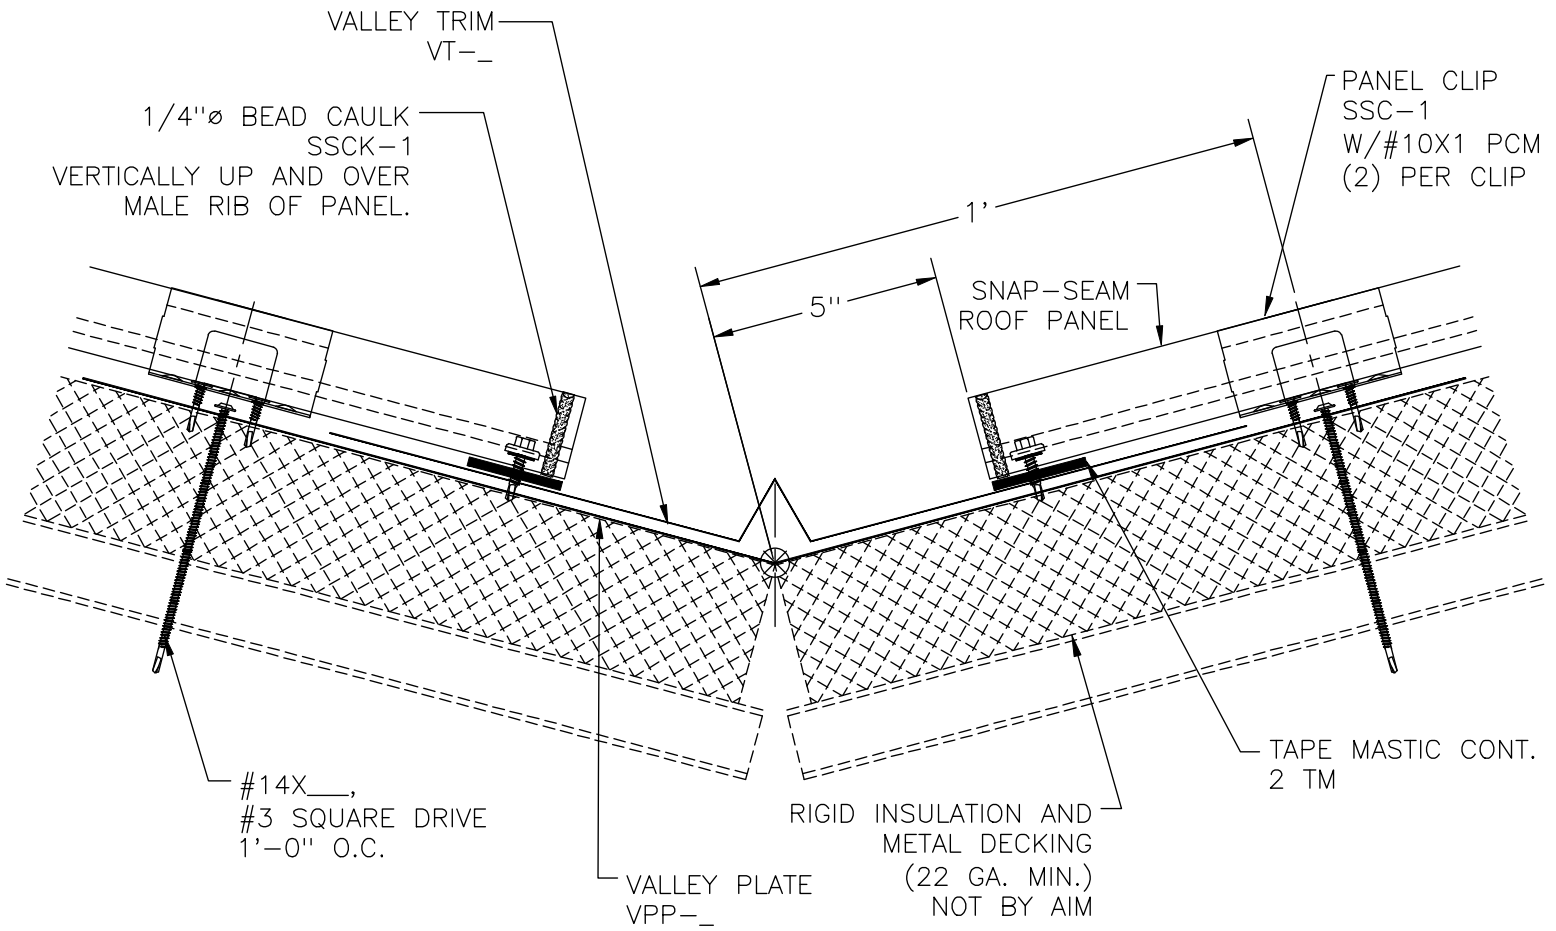

NOTE: AT VALLEY FLASHING LAP 2" MAX.  
2 TM ACROSS THE LAP WITH  
(6) #14X1 SDLL ROOF FASTENERS.

STANDARD VALLEY ON MDRB  
FOR SNAP-SEAM PANELS



SCALE: NONE

DATE:


DRAWN BY: KP

03/02/09

CHECKED BY:

REVISED BY:

SNAP-SEAM  
STANDARD VALLEY  
ON RIGID INSULATION  
AND METAL DECKING

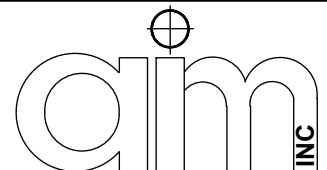

DWG NO:

SS.8.B.3